

ELECTRICITY GENERATING AUTHORITY OF THAILAND

Supplemental Notice No. 4

Invitation to Bid No. TIPN-S-05

**Supply and Construction of 500/230 kV Lamphun 3 (GIS) and
500 kV Mae Moh 3 (GIS) Substations**

**Transmission System Improvement Project in Upper Northern Region
to Enhance System Security**

(Two-Envelope)

The attached Supplemental Notice shall be considered as part of the bidding documents No. TIPN-S-05.

As acknowledgement of receipt that all additions, deletions and revisions contained in this Supplemental Notice are incorporated into the above bidding documents, Bidder is requested to sign and return this acknowledgement via email address : pirada.s@egat.co.th within three (3) days from the date of the announcement of this Supplemental Notice on <http://www4.egat.co.th/fprocurement/biddingeng/>.

The original acknowledgement which is manually signed in ink by a person or persons duly authorized shall be included in the proposal to be submitted on the bid opening date.

ELECTRICITY GENERATING AUTHORITY OF THAILAND

.....September 20, 2022.....

ACKNOWLEDGEMENT

This undersigned Bidder hereby certifies that the additions, deletions and revisions set forth in this Supplemental Notice to Invitation to Bid No. TIPN-S-05 are incorporated as part of the above bidding documents and will be fully included in any bids which he may submit.

Signed _____

Title _____

Company _____

Date _____

ELECTRICITY GENERATING AUTHORITY OF THAILAND

SUPPLEMENTAL NOTICE NO. 4

INVITATION TO BID NO. TIPN-S-05

SUPPLY AND CONSTRUCTION OF 500/230 kV LAMPHUN 3 (GIS) AND
500 kV MAE MOH 3 (GIS) SUBSTATIONSTRANSMISSION SYSTEM IMPROVEMENT PROJECT IN UPPER
NORTHERN REGION TO ENHANCE SYSTEM SECURITY

The following supplemental information is hereby given for the above described Invitation:

Volume I of IV

1. Section A : Invitation to Bid

Postpone the price and technical proposals submission date from August 23, 2022 to ***October 5, 2022***.

Volume IV of IV


2. Section L : Drawings

Replace Dwg. No. LN3-S-2 sheet 01/01 with the revised one with (Rev.1) attached.

Bid submitted must be in accordance with this Notice. Receipt of this Notice shall be acknowledged by the Bidder on the proposal included in the Bidding Documents in the space provided on page Part 3 - C22, Article C-5 Supplemental Notices.

ELECTRICITY GENERATING
AUTHORITY OF THAILAND

.....September 20, 2022.....

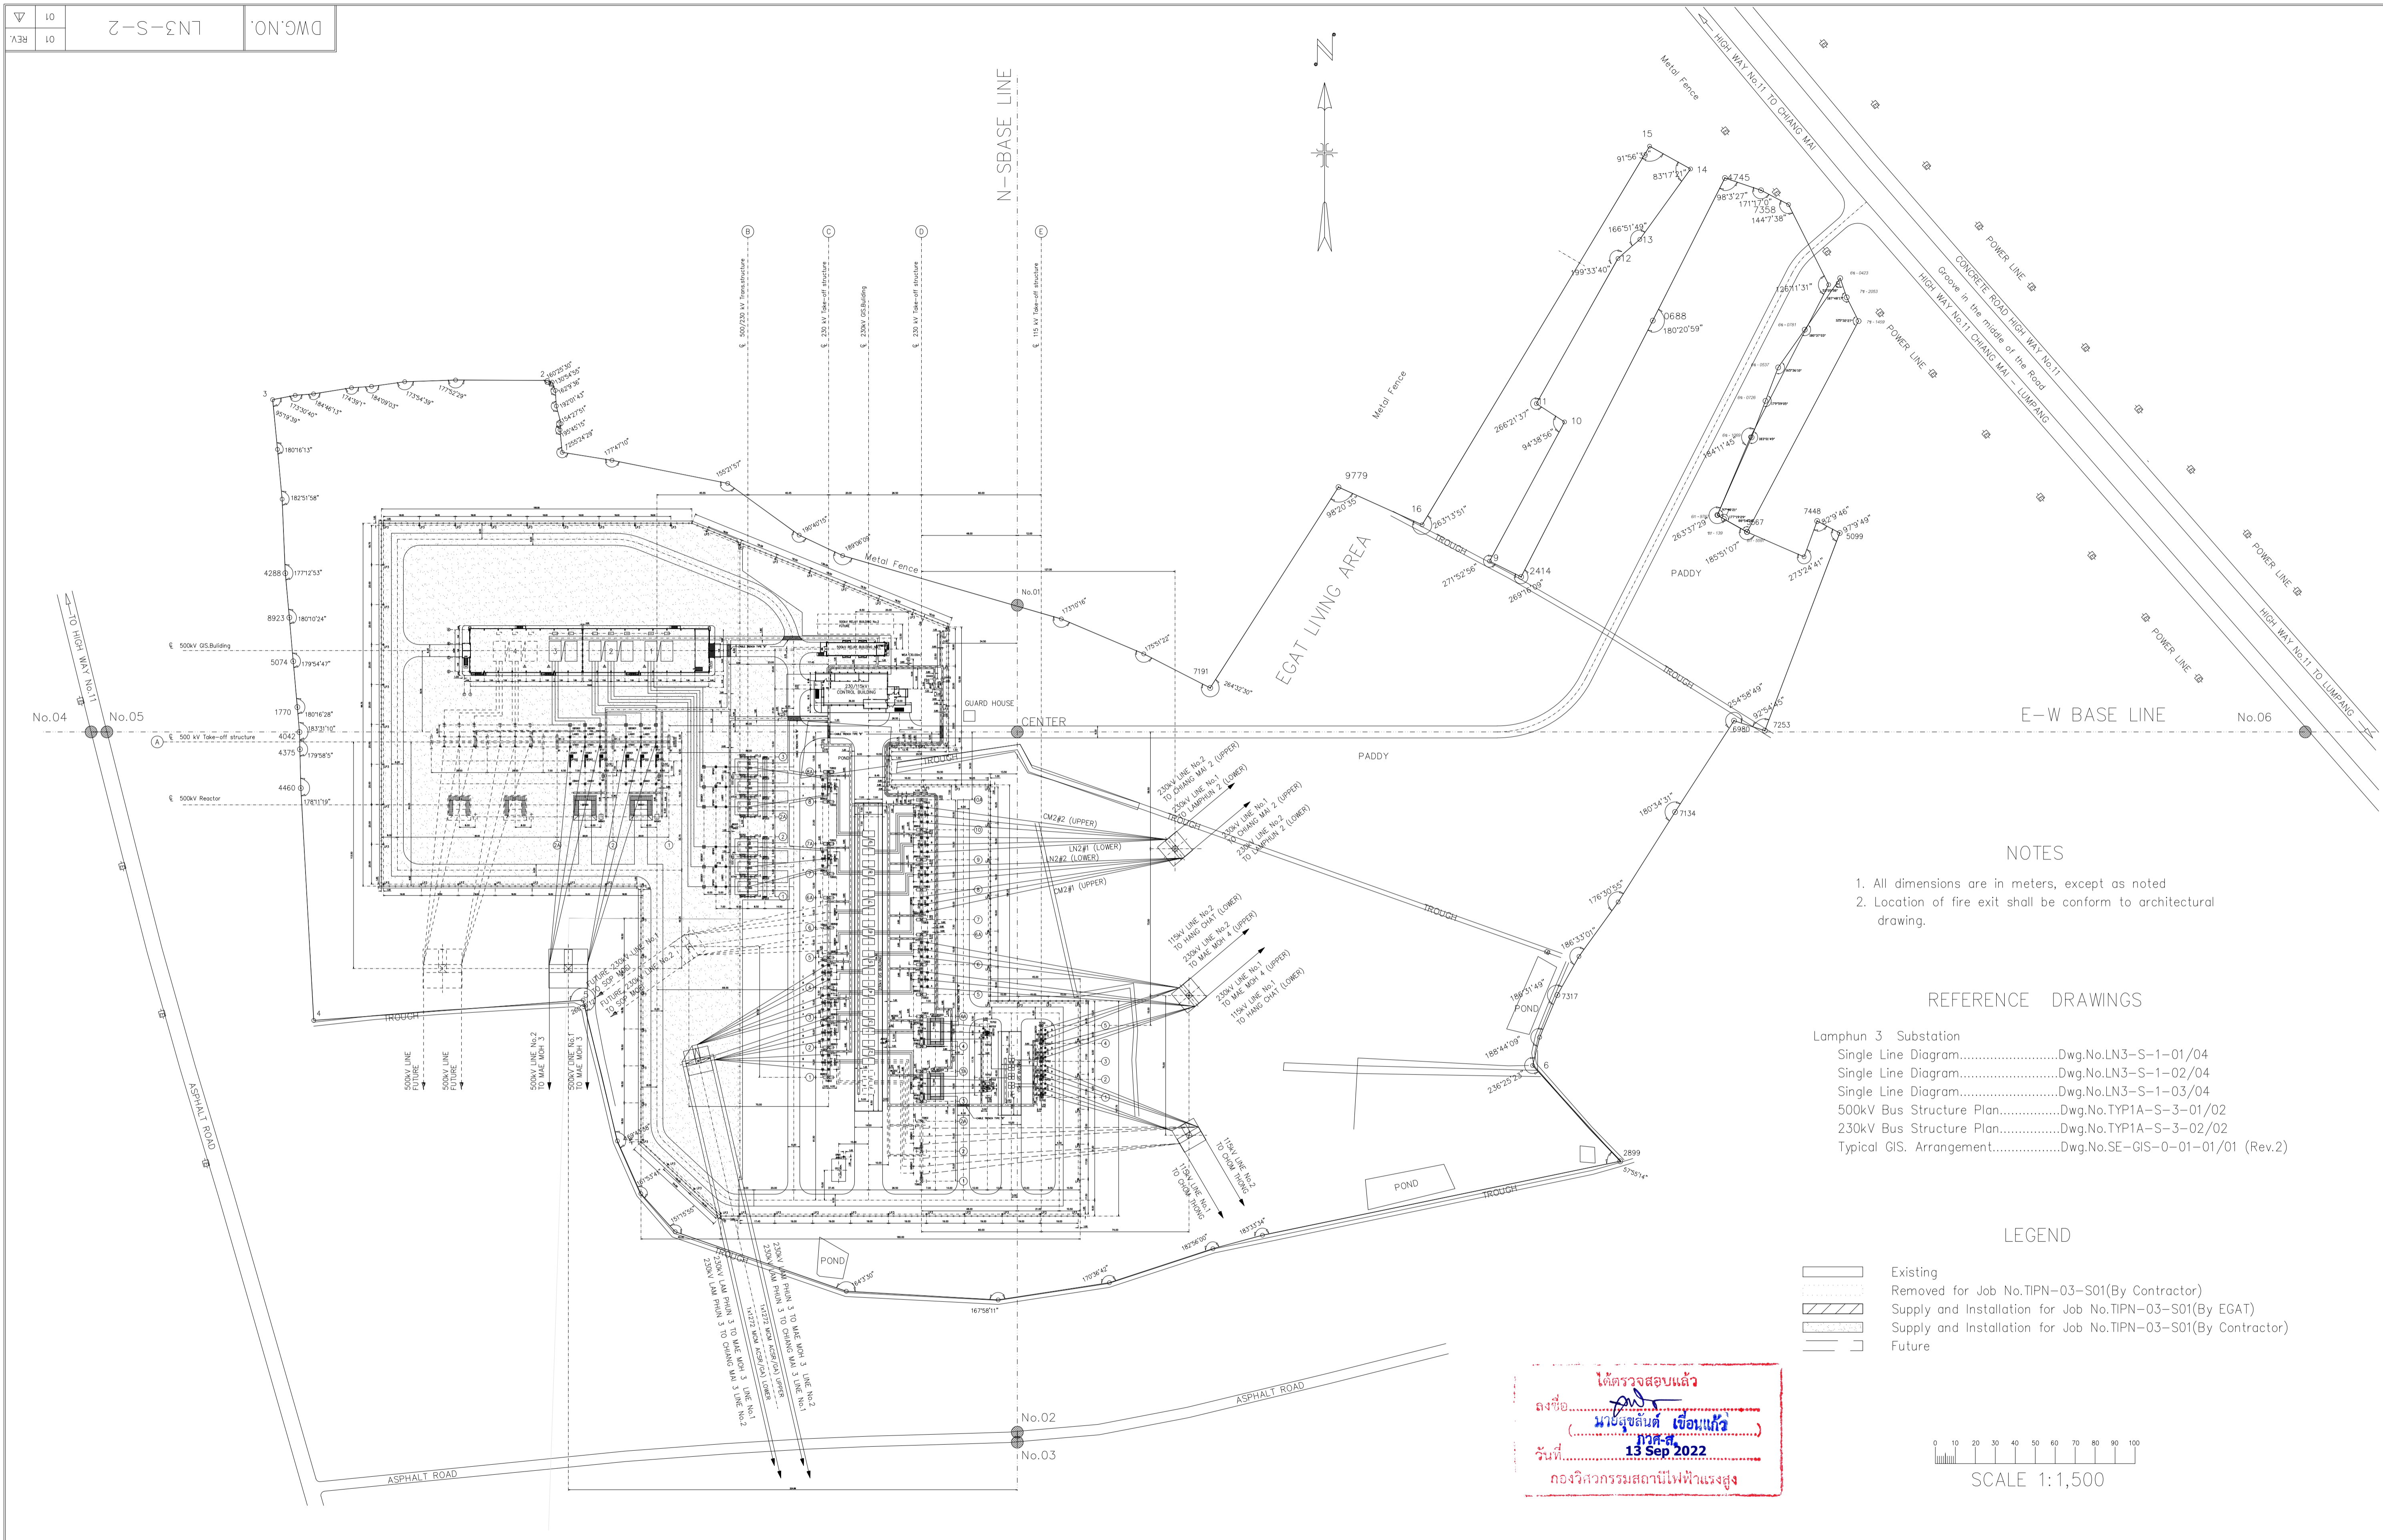

NOTES

- All dimensions are in meters, except as noted
- Location of fire exit shall be conform to architectural drawing.


REFERENCE DRAWINGS

- Lamphun 3 Substation
- Single Line Diagram.....Dwg.No.LN3-S-1-01/04
 - Single Line Diagram.....Dwg.No.LN3-S-1-02/04
 - Single Line Diagram.....Dwg.No.LN3-S-1-03/04
 - 500kV Bus Structure Plan.....Dwg.No.TYP1A-S-3-01/02
 - 230kV Bus Structure Plan.....Dwg.No.TYP1A-S-3-02/02
 - Typical GIS Arrangement.....Dwg.No.SE-GIS-0-01-01/01 (Rev.2)

LEGEND

- Existing
- Removed for Job No.TIPN-03-S01(By Contractor)
- Supply and Installation for Job No.TIPN-03-S01(By EGAT)
- Supply and Installation for Job No.TIPN-03-S01(By Contractor)
- Future

ได้ตรวจสอบแล้ว
 ลงชื่อ...
 นายสุวัฒน์ ใจแก้ว
 (.....)
 วันที่ 13 Sep 2022
 กองวิศวกรรมสถานีไฟฟ้าแรงสูง

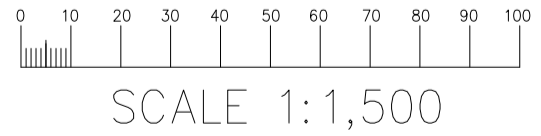

ELECTRICITY GENERATING AUTHORITY OF THAILAND

DRAWN	VALIDATED	DRAWING NAME
DESIGNED	RECOMMENDED	LAMPHUN 3 SUBSTATION
VERIFIED	CONCURRED	DESCRIPTION OF DETAIL DRAWING
APPROVED	DIRECTOR, TRANSMISSION SYSTEM ENGINEERING DIVISION	GENERAL ARRANGEMENT PLAN
ASSISTANT GOVERNOR - TRANSMISSION SYSTEM DEVELOPMENT	DATE	JOB NO. TIPN-03-S01
		REPLACING DWG. NO.
		DWG. NO. LN3-S-2
		REV. 01

REV. NO.	JOB NO.	JOB DESCRIPTION	DRAWN	DESIGNED	VERIFIED	VALIDATED	RECOMMENDED	CONCURRED	APPROVED	DATE
Δ	TIPN-03-S01	REVISED GIB ROUTE								
-	TIPN-03-S01	NEW 500kV GAS INSULATED SUBSTATION (GIS.)								